

AC-162 Peltier-Thermoelectric Air Cooler



- Ideal for refrigerators and biomedical equipment where cooling to near freezing temperatures is desired. Also good for electronic enclosures.
- High efficiency cold sink keeps the temperature difference between the enclosure's air and the cold sink to a minimum. This is especially useful for cooling to enclosure temperatures near 0 °C where other, less efficient cold sinks would allow condensation to freeze and restrict air flow.
- Large capacity cooling in small space made possible by high fin density heat sinks.
- Maintains enclosure at NEMA 12 rating, but can be customized for NEMA 4.
- Can easily be customized for production sized orders to meet your exact requirements.
- CE marked, RoHS compliant.

TE  [®]
TECHNOLOGY, INC.

Expert Engineering, Precision Manufacturing:
Quality Thermal Solutions Delivered

<https://totech.com/> • cool@totech.com • 231-929-3966 • 1590 Keane Drive • Traverse City, MI 49696

AC-162 Specifications

Thermoelectric (TE) Power (typical) ^{1,3} :	24 VDC at 14.1 A
Thermoelectric (TE) Power (maximum) ^{2,3} :	24 VDC at 17.1 A
External (ambient) Fan Power:	24 VDC at 1.0 A
Internal (enclosure) Fan Power:	24 VDC at 0.22 A
External (ambient) Fan Noise:	55 dBA
Internal (enclosure) Fan Noise:	39 dBA

NEMA Rating: 12

Weight (kg): 7.5



! Please review the [Thermoelectric Cooling Assembly \(TCA\) Instruction Manual](#) (or [manual in other languages](#)), [ordering information](#), and [FAQ's](#) for related technical information before purchasing or using this product.

Performance is based on unrestricted air flow to fans and from air-flow outlets. Do not operate if the ambient, enclosure air, heat sink, or cold sink temperatures exceed 70 °C. Do not operate fan at air temperatures below -20 °C or above 70 °C.

¹Current, at steady state, is rated at +25 °C ambient, +25 °C internal, maximum heat removal. At -10 °C internal, the typical steady-state current is 13.8 A.

²Current, at steady-state operation under-worst case conditions, is rated at -20 °C ambient, +70 °C internal, maximum heat removal.


³Total current consumption is sum of TE current and Fan current.

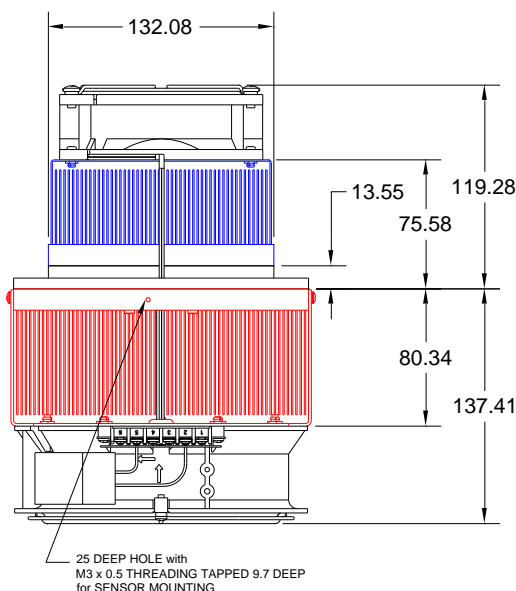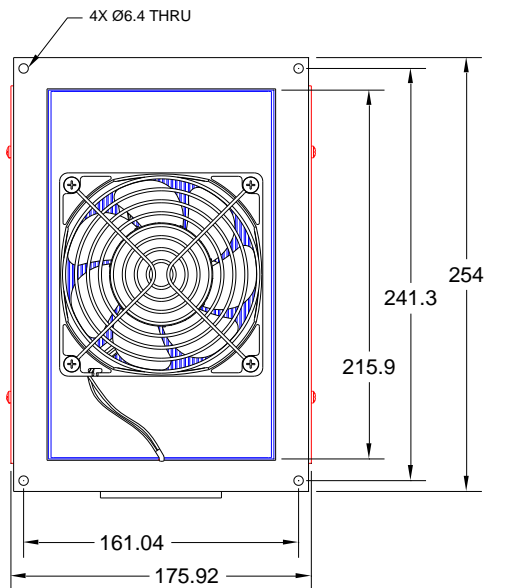

RoHS Compliant
Directive 2011/65/EU

A 3D PDF, .stp, and .x_t solid models are also available from the website.

All dimensions in millimeters.
Internal (enclosure) side shown in blue;
External (ambient) side shown in red.

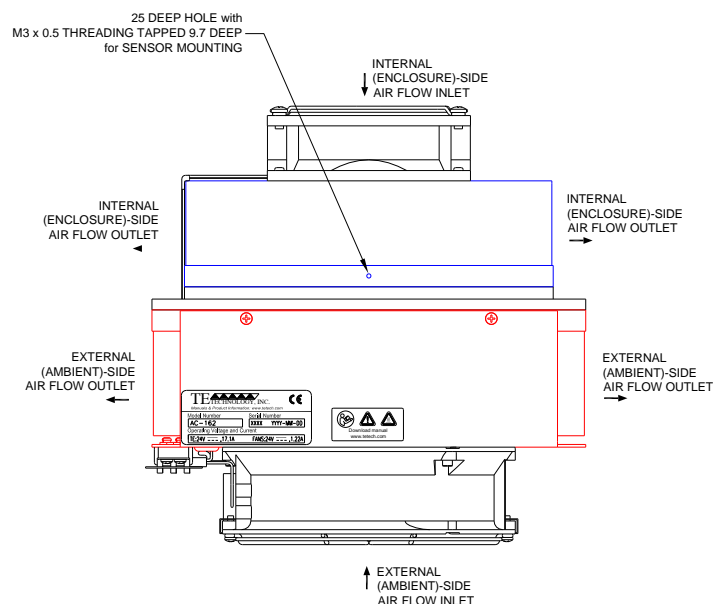


TE TECHNOLOGY, INC.®

Expert Engineering, Precision Manufacturing:
Quality Thermal Solutions Delivered

<https://totech.com/> • cool@totech.com • 231-929-3966 • 1590 Keane Drive • Traverse City, MI 49696

AC-162 Cooling Performance Graph

(removing heat from enclosure)

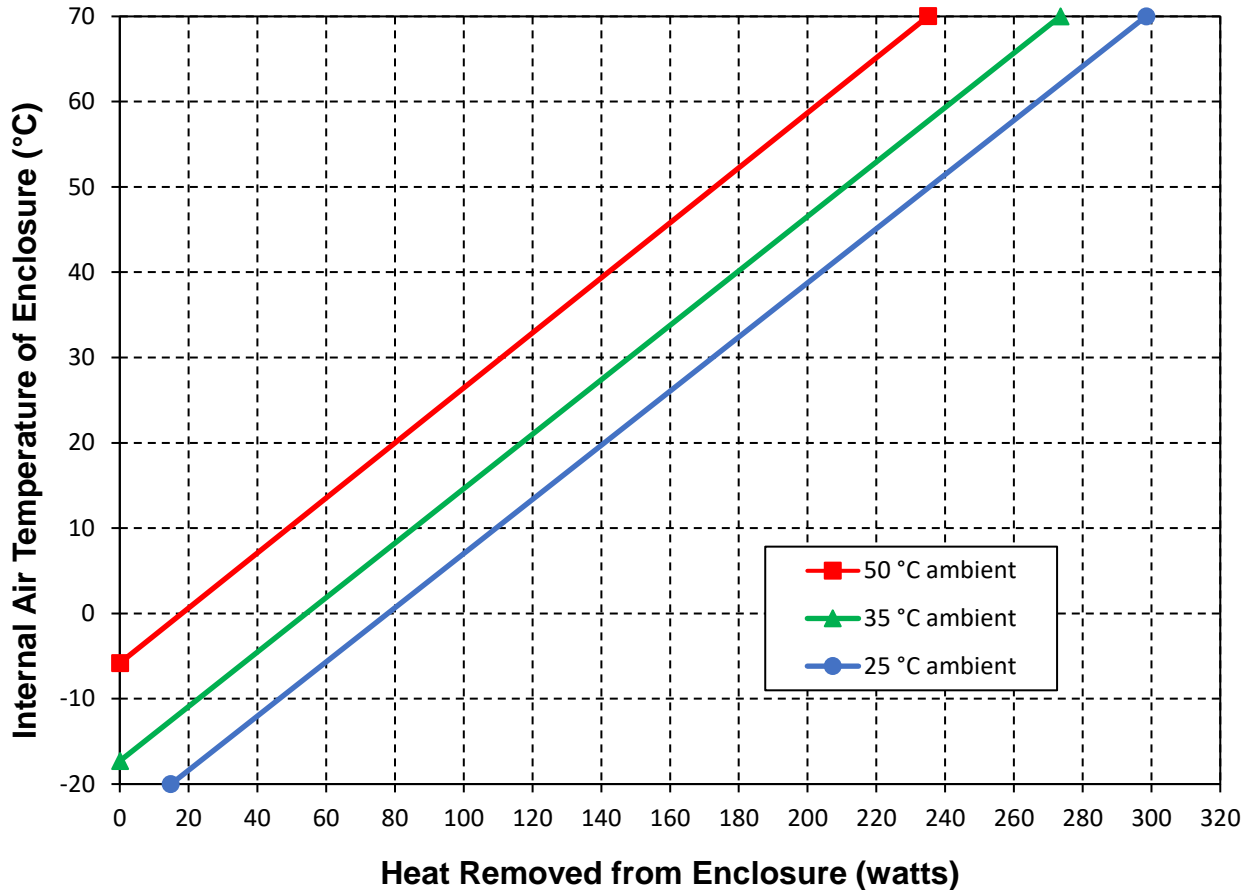

How to use the Performance Graph:

1. Select Performance Line

The diagonal lines represent cooling performance at the indicated ambient air temperature (intake temperature on the ambient-side fan). If the cooler is to operate at a different ambient, then you must sketch in a new performance line. This can be drawn parallel to one of the existing lines, using the distance between the existing lines as a scale to properly locate the new line.

2. Select Enclosure Temperature

Draw a horizontal line on the graph corresponding to the desired internal air temperature of the enclosure. Make the line intersect with the performance line corresponding to the ambient temperature at which the cooler is to operate.

3. Determine Cooling Capacity

The maximum amount of heat that the cooler can remove from the enclosure is determined by the intersection point (determined in the previous step). *The cooler will be able to maintain the desired enclosure temperature if the cooling capacity exceeds the heat load. If the heat load exceeds the cooling capacity then a higher capacity cooler will be needed.*

Example: You need to maintain the enclosure at 15 °C while in a 25 °C ambient. The cooler can remove a maximum of approximately 127 W of heat from the enclosure. If the heat load (internally generated heat plus the heat gain through insulation, solar, vapor condensation, etc.) in the enclosure exceeds this, you would need more coolers and/or a larger cooler.


TE TECHNOLOGY, INC.®

Expert Engineering, Precision Manufacturing:
Quality Thermal Solutions Delivered

<https://totech.com/> • cool@totech.com • 231-929-3966 • 1590 Keane Drive • Traverse City, MI 49696

AC-162 Heating Performance Graph

(adding heat to enclosure)

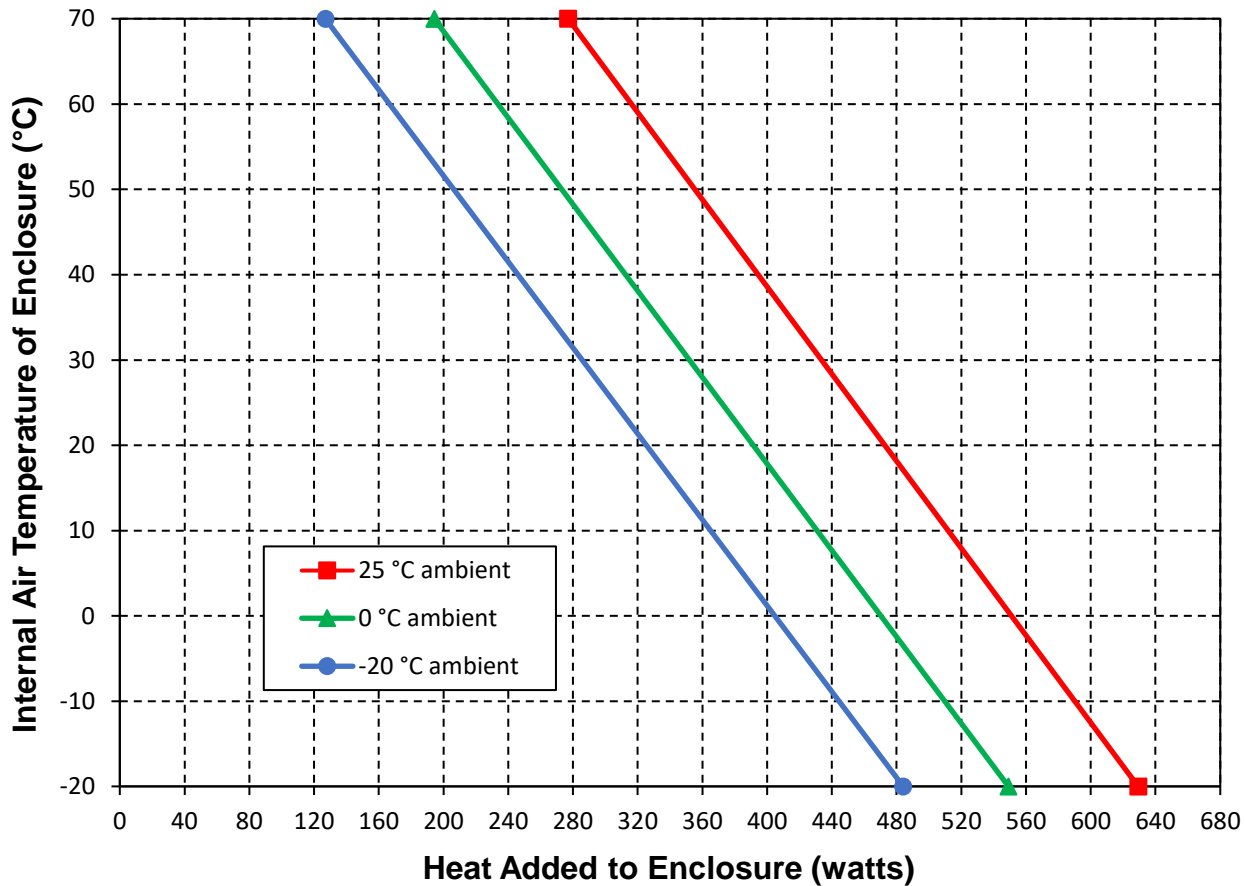

How to use the Performance Graph:

1. Select Performance Line

The diagonal lines represent heating performance at the indicated ambient air temperature (intake temperature on the ambient-side fan). If the cooler is to operate at a different ambient, then you must sketch in a new performance line. This can be drawn parallel to one of the existing lines, using the distance between the existing lines as a scale to properly locate the new line.

2. Select Enclosure Temperature

Draw a horizontal line on the graph corresponding to the desired internal air temperature of the enclosure. Make the line intersect with the performance line corresponding to the ambient temperature at which the cooler is to operate.

3. Determine Heating Capacity

The maximum amount of heat that the cooler can add to the enclosure is determined by the intersection point (determined in previous step). *If the heat added to the enclosure (including heat generated by equipment inside) is greater than the enclosure's heat loss, then the cooler will be able to heat to the desired temperature. A higher capacity cooler will be needed if the total heat added is less than the enclosure's heat loss.*

Example: You need to maintain the enclosure at 20 °C while in a 0 °C ambient. The cooler can add a maximum of approximately 392 W of heat from the enclosure. If the heat dissipation from the enclosure exceeds this (plus anything else generating heat), you would need more coolers and/or a larger cooler.

TE TECHNOLOGY, INC.®


Expert Engineering, Precision Manufacturing:
Quality Thermal Solutions Delivered

<https://totech.com/> • cool@totech.com • 231-929-3966 • 1590 Keane Drive • Traverse City, MI 49696


Terminal Block Configuration for Continuous Operation at Full Power

As-Shipped Configuration 1 of 2

1

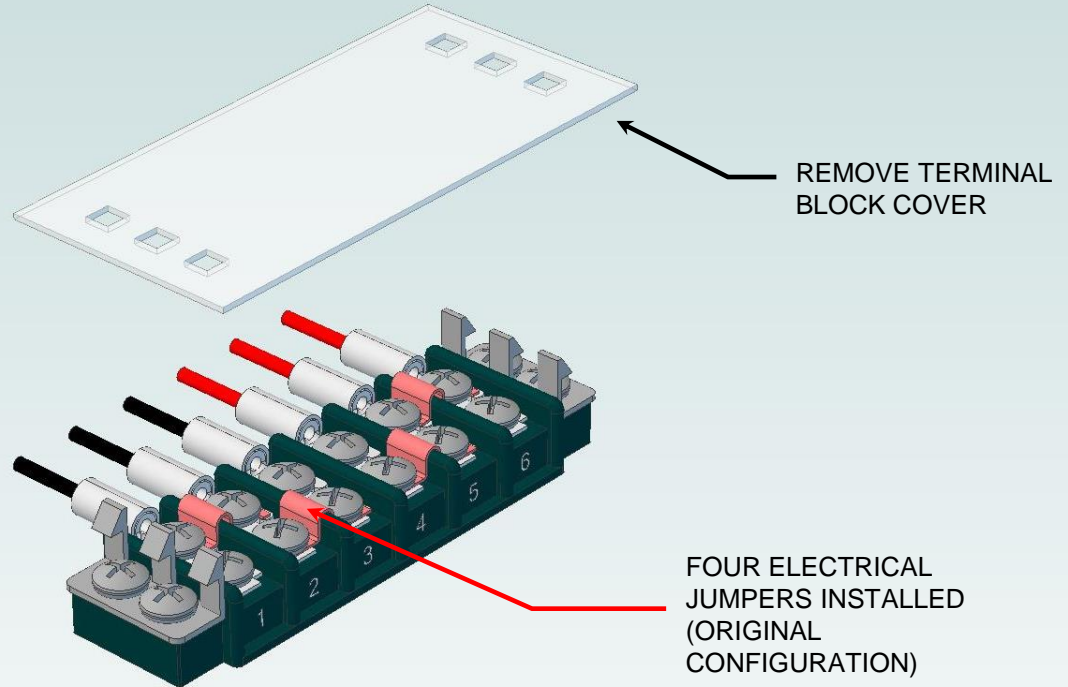

2

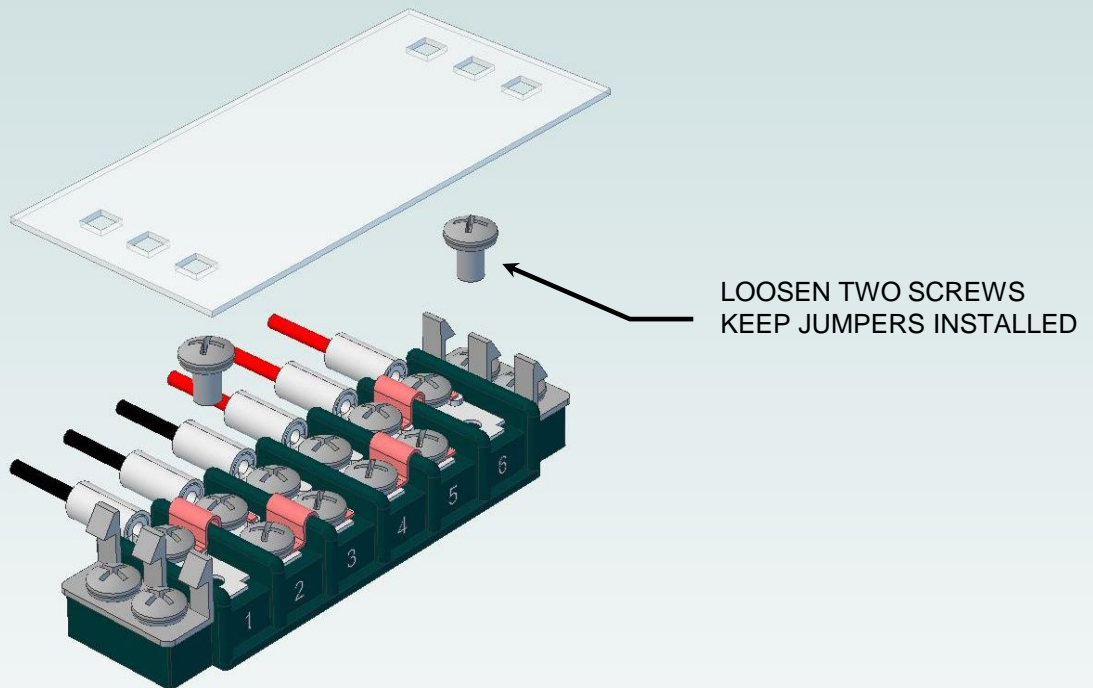



TE TECHNOLOGY, INC.®

Expert Engineering, Precision Manufacturing:
Quality Thermal Solutions Delivered

<https://totech.com/> • cool@totech.com • 231-929-3966 • 1590 Keane Drive • Traverse City, MI 49696

Terminal Block Configuration for Continuous Operation at Full Power

2 of 2

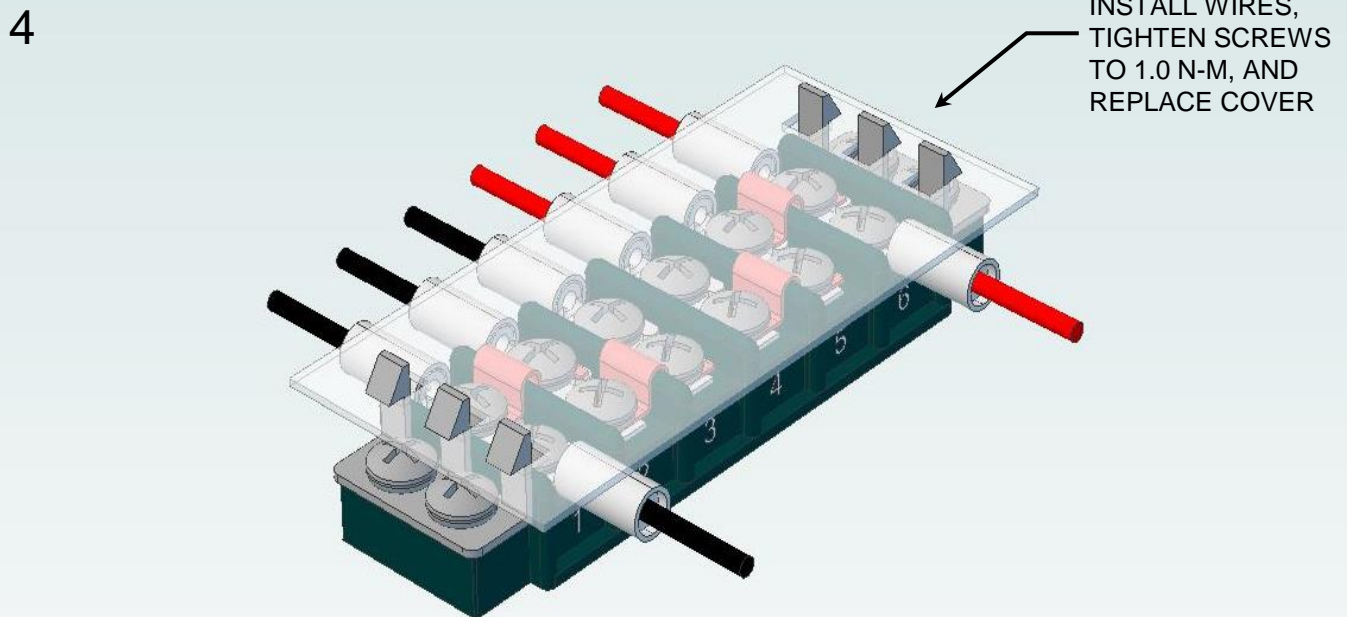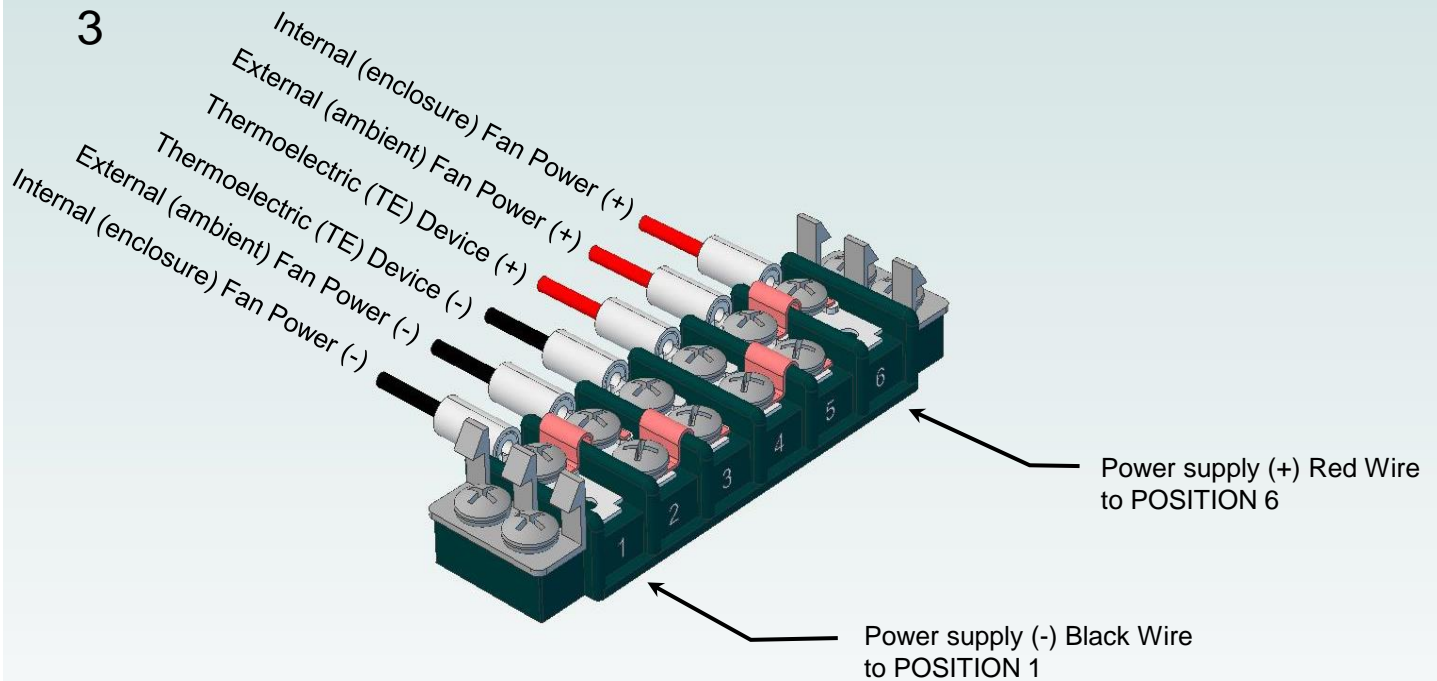



TE TECHNOLOGY, INC.®

Expert Engineering, Precision Manufacturing:
Quality Thermal Solutions Delivered

<https://totech.com/> • cool@totech.com • 231-929-3966 • 1590 Keane Drive • Traverse City, MI 49696

Terminal Block Configuration for Operation with Temperature Controller

1 of 2

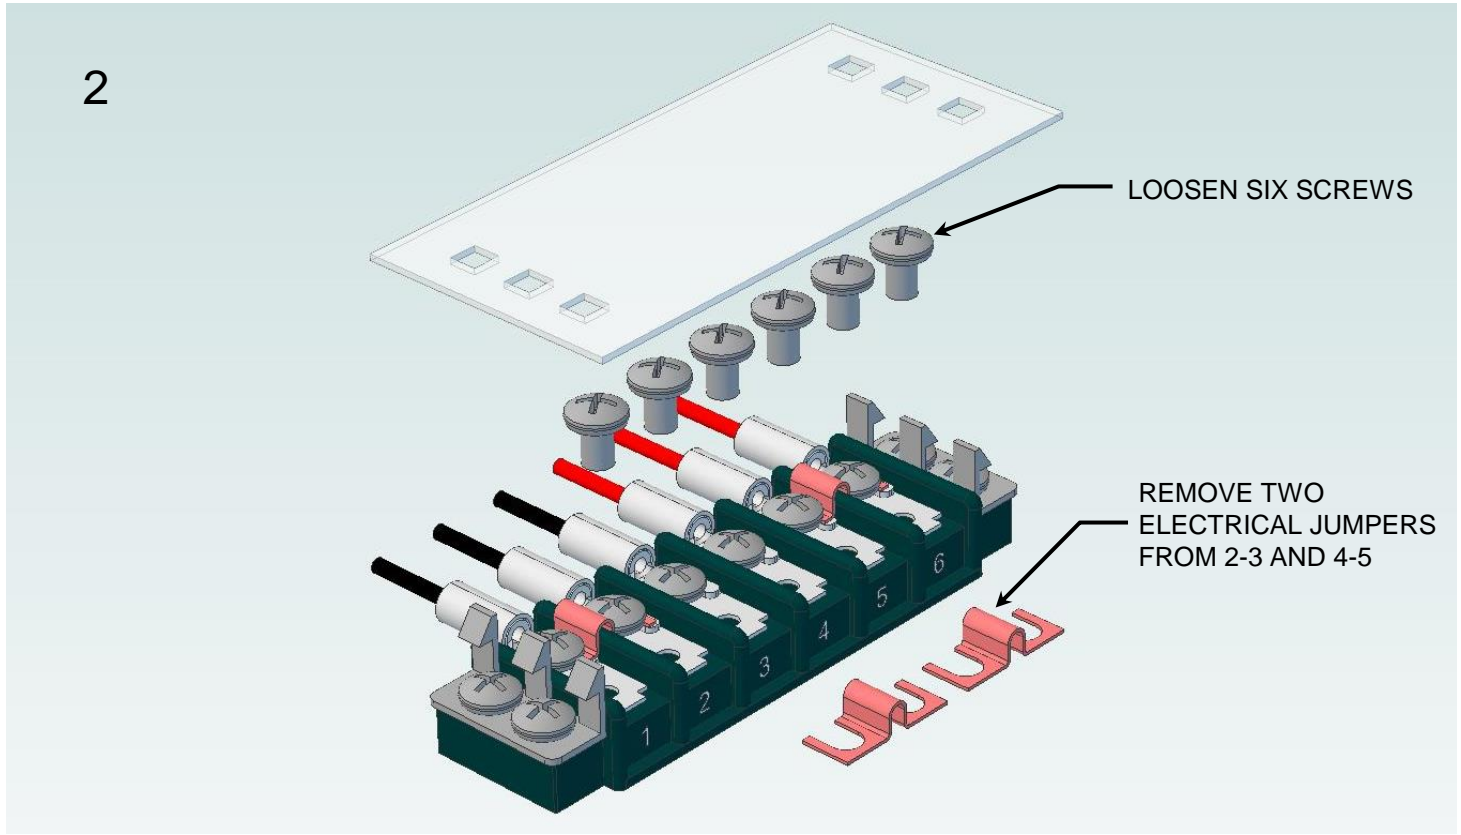
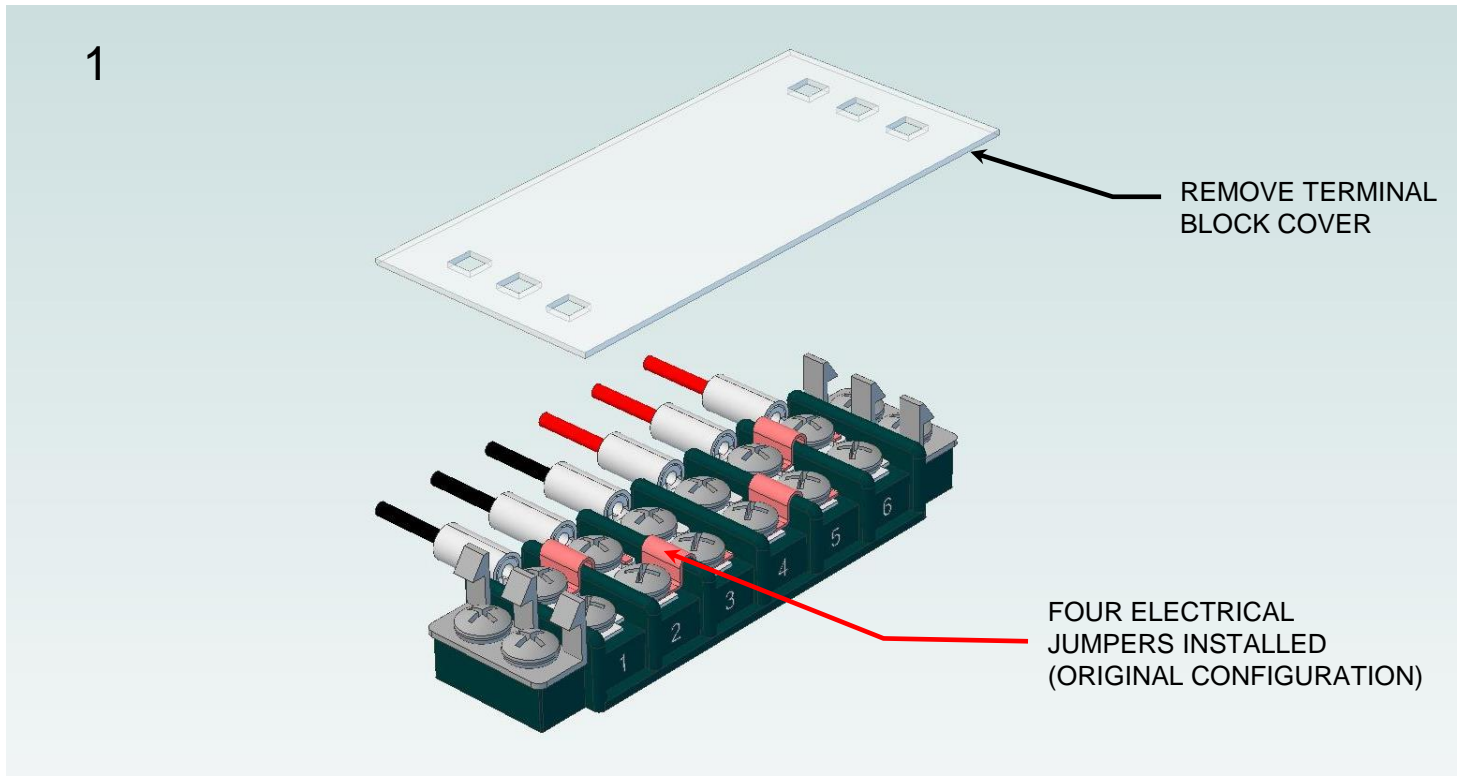


Expert Engineering, Precision Manufacturing:
Quality Thermal Solutions Delivered

<https://totech.com/> • cool@totech.com • 231-929-3966 • 1590 Keane Drive • Traverse City, MI 49696

Terminal Block Configuration for Operation with Temperature Controller

2 of 2

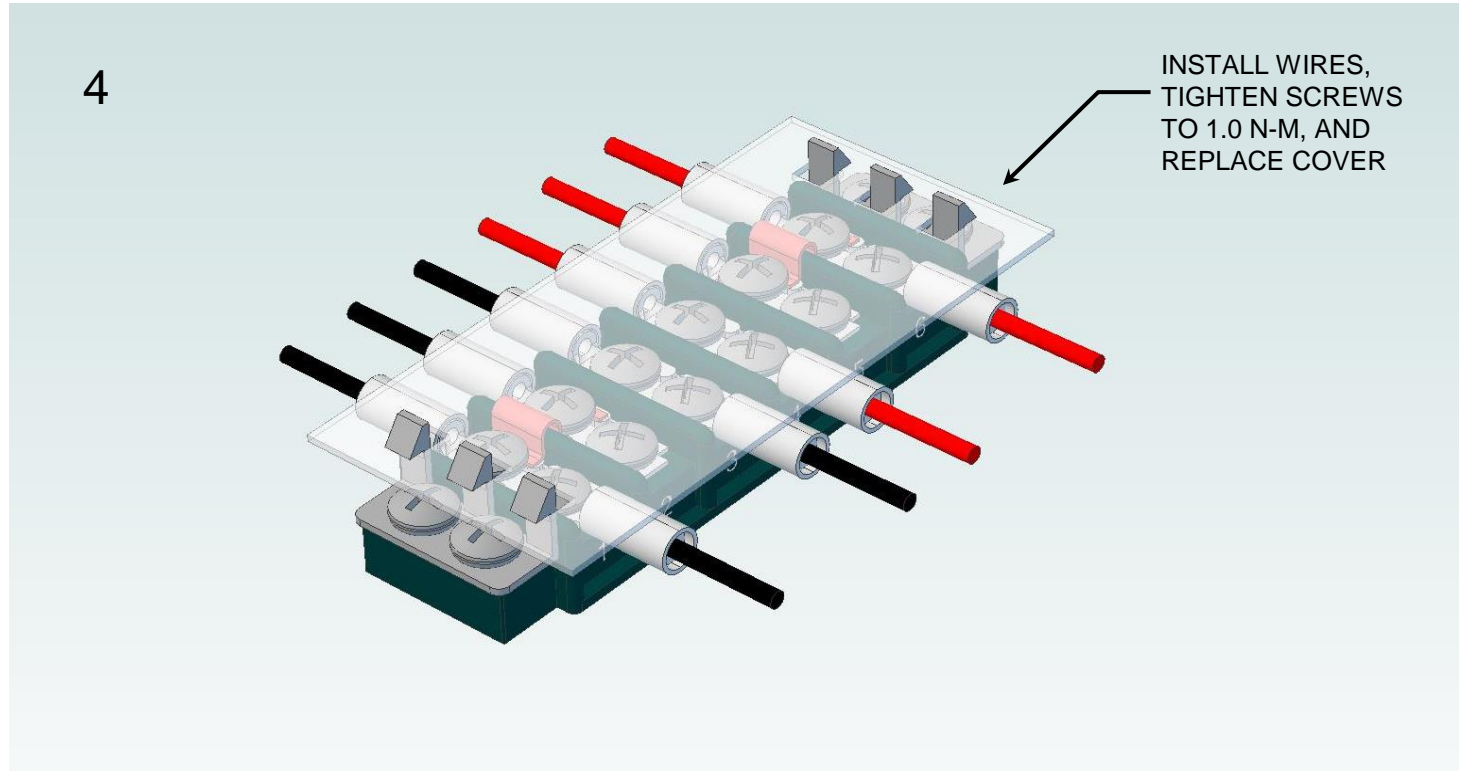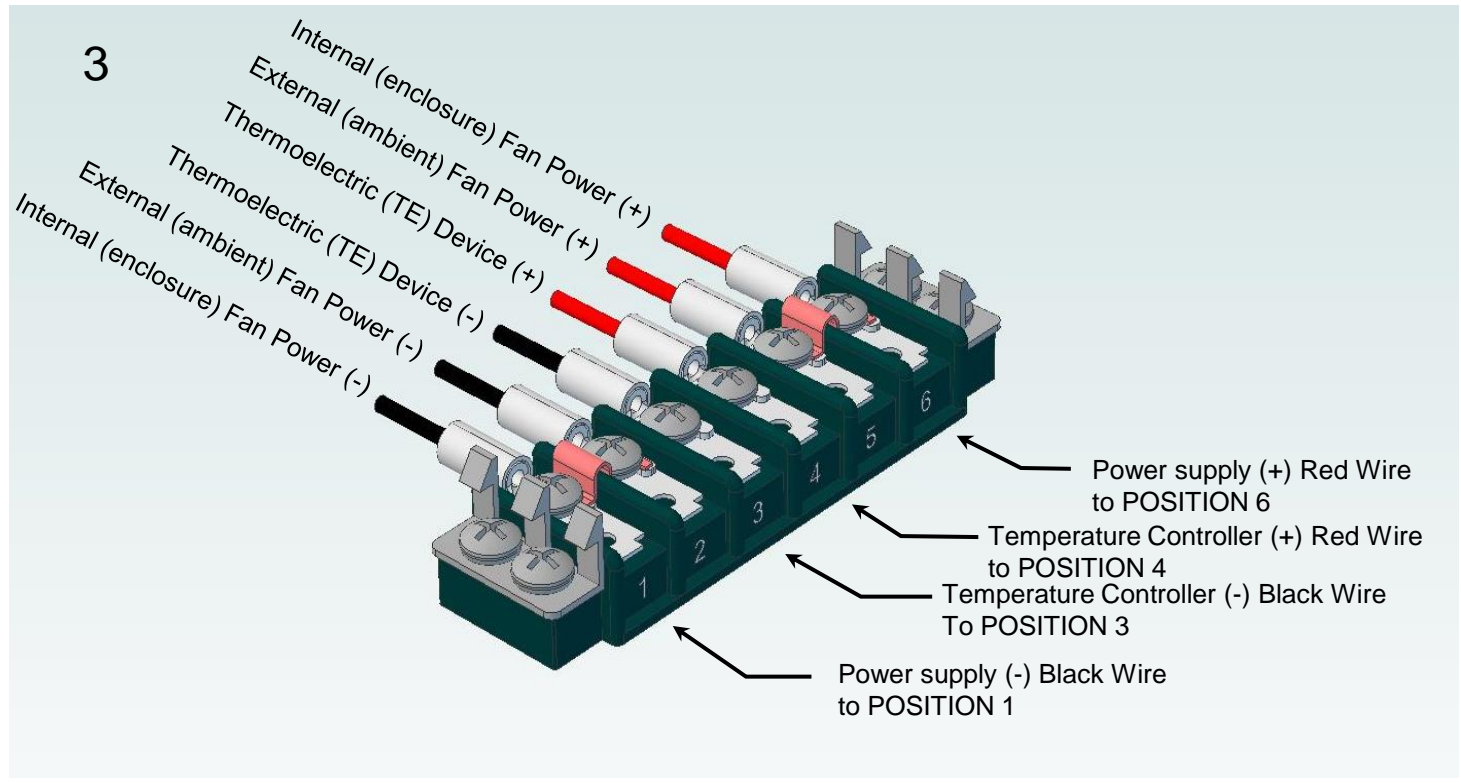

Expert Engineering, Precision Manufacturing:
Quality Thermal Solutions Delivered

<https://totech.com/> • cool@totech.com • 231-929-3966 • 1590 Keane Drive • Traverse City, MI 49696